


# DETAIL

## DETAIL-BK-TRI DETAIL-WH-TRI

This range of Haneco Lighting LED products have been tested as AS/NZS60598.2.2:2001 standards and are approved to the luminaire will not exceed 90°C when side abut or covered with ceiling insulation.

Building insulation is used to abut and cover the luminaire must meet the following requirement:


1. Be of a type that can maintain it's dimensions and structural integrity when exposed to the maximum surface temperatures of the class of luminaire, being 90°C and must withstand a 30s needle flame test carried out in accordance with AS/NZS 60695.11.5 with the flame applied to all surfaces of the sample.
2. (New Zealand only) Loose fill insulation as defined in NZS4246 is not permitted to abut or cover this luminaire.



INFO & WARNING	
The minimum clearance distance from the top of the luminaire to any normally flammable building element (mm) .....	0mm
The minimum clearance distance from the top of the luminaire to any building insulation (mm) .....	0mm
The minimum clearance distance from the side of the luminaire to any normally flammable building element (mm) ...	0mm
The minimum clearance distance from the side of the luminaire to any normally building insulation (mm) .....	0mm

### \*Installation Instructions:

1. Take LED fitting out from box.
2. Cut a hole as per instruction below.
3. Select CCT setting (3000k,4000k,5700k).
4. Put the plug into the socket.
5. Insert LED Downlight into the pre-cutted hole while gently releasing mounting springs.
6. Place the driver above the insulation as far from the luminaire as the lead allows

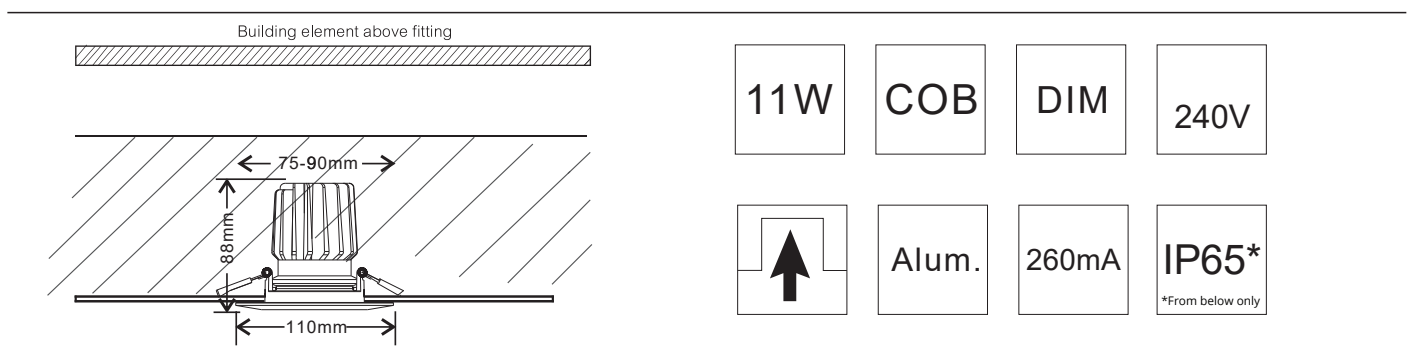

Installation of the product is to be completed by a licenced electrician, in accordance with these instructions, relevant Australia standards and local regulations.

PRODUCT CODE: DETAIL-BK-TRI  
DETAIL-WH-TRI